

Legend

- Assessment Area
- Solar PV Development Footprint
- Existing Access Roads
- Access Points
- Existing Structures
- Spitskop/Gaberone South 2 132kV OHL
- Dwarsberg/Segodishane 1 132 kV OHL
- Proposed Fences
- Proposed Internal Roads
- O&M/laydown Area
- BESS Assessment Area
- BESS Development Area
- PV Panels
- Substation & O&M Complex 1 (Alternative 1)
- Substation & O&M Complex 2 (Alternative 2)
- Substation & O&M Complex 3 (Alternative 3)
- OHL Route 1 Corridor (Alternative 1)
- OHL Route 2 Corridor (Alternative 2)
- OHL Route 3 Corridor (Alternative 3)



Benya Solar PV Facility & Grid Connection near Northam, Limpopo Province

Site Layout Plan - All Alternatives



Legend


- Assessment Area
- Solar PV Development Footprint
- Existing Access Roads
- Access Points
- Existing Structures
- Spitskop/Gaberone South 2 132kV OHL
- Dwarsberg/Segodishane 1 132 kV OHL
- Dams
- Proposed Fences
- Proposed Internal Roads
- O&M/laydown Area
- BESS Assessment Area
- BESS Development Area
- PV Panels
- Substation & O&M Complex 1 (Alternative 1)
- Substation & O&M Complex 2 (Alternative 2)
- Substation & O&M Complex 3 (Alternative 3)
- OHL Route 1 Corridor (Alternative 1)
- OHL Route 2 Corridor (Alternative 2)
- OHL Route 3 Corridor (Alternative 3)

Environmental Sensitivities

- 1km Seasonal Vulture Nest Buffer
- Terrestrial Biodiversity No-Go
- Wetland
- 32m Wetland No-Go Buffer
- Monument
- 100m Monument No-Go Buffer
- Visual No-Go
- CBA 2
- ESA 2
- Madikwe-Atherstone KBA

Benya Solar PV Facility & Grid Connection near Northam, Limpopo Province

Site Layout Plan - All Alternatives with Environmental Sensitivities

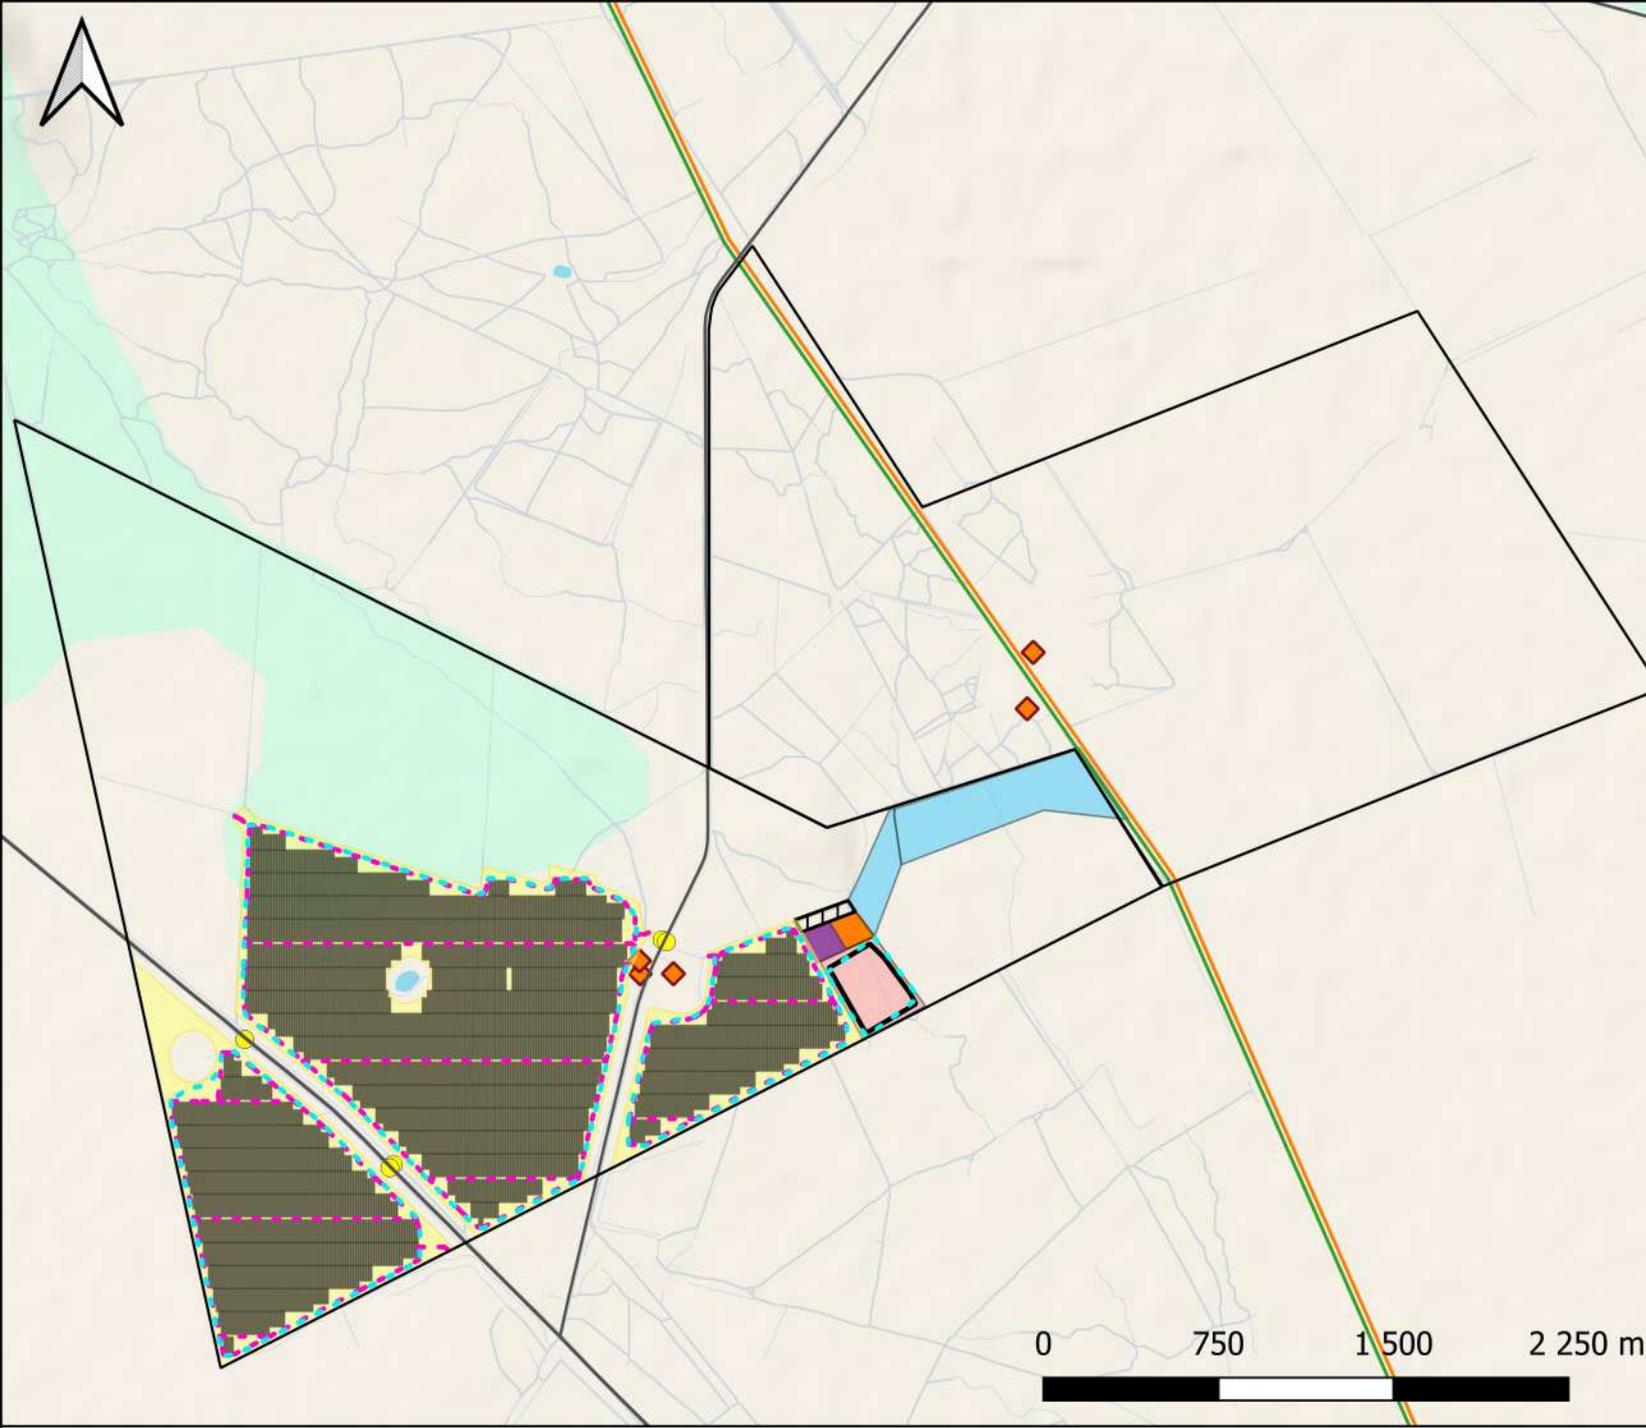

Legend

- Assessment Area
- Solar PV Development Footprint
- Existing Access Roads
- Access Points
- Existing Structures
- Spitskop/Gaberone South 2 132kV OHL
- Dwarsberg/Segodishane 1 132 kV OHL
- Proposed Fences
- Proposed Internal Roads
- O&M/laydown Area
- BESS Assessment Area
- BESS Development Area
- PV Panels
- IPP 33/132kV Step-Up Sub (Sub&O&M Complex 2)
- Eskom 132kV Switching Sub (Sub&O&M Complex 2)
- OHL Route 1 Corridor (Alternative 1)

Benya Solar PV Facility & Grid Connection near Northam, Limpopo Province

Site Layout Plan - Preferred Alternatives




Legend

- Assessment Area
- Solar PV Development Footprint
- Existing Access Roads
- Access Points
- Existing Structures
- Spitskop/Gaberone South 2 132kV OHL
- Dwarsberg/Segodishane 1 132 kV OHL
- Dams
- Proposed Fences
- Proposed Internal Roads
- O&M/laydown Area
- BESS Assessment Area
- BESS Development Area
- PV Panels
- IPP 33/132kV Step-Up Sub (Sub&O&M Complex 2)
- Eskom 132kV Switching Sub (Sub&O&M Complex 2)
- OHL Route 1 Corridor (Alternative 1)

Environmental Sensitivities

- 1km Seasonal Vulture Nest Buffer
- Terrestrial Biodiversity No-Go
- Wetland
- 32m Wetland No-Go Buffer
- Monument
- 100m Monument No-Go Buffer
- Visual No-Go
- CBA 2
- ESA 2
- Madikwe-Atherstone KBA



Benya Solar PV Facility & Grid Connection near Northam, Limpopo Province

Site Layout Plan - Preferred Alternatives with Environmental Sensitivities